










LEGEND	
	EXISTING STREET/SITE LIGHTING (SUBJECT TO IDENTIFICATION ON SITE)
	PROPOSED PUBLIC LIGHTING DUCTING ROUTE. DUCTS SHALL BE uPVC COMPLYING WITH BS3506 CLASS B OR HIGH DENSITY POLYTHENE PIPE TO I.S.135 CLASS B. MINIMUM SIZE 50mm WITH 100mm SPARE DUCTS DEPLOYED AT ROAD CROSSINGS.
	PROPOSED PUBLIC LIGHTING DUCTING ROUTE. DUCTS SHALL BE uPVC COMPLYING WITH BS3506 CLASS B OR HIGH DENSITY POLYTHENE PIPE TO I.S.135 CLASS B. MINIMUM SIZE 100mm WITH 100mm SPARE DUCTS DEPLOYED AT ROAD CROSSINGS.
	PROPOSED PUBLIC LIGHTING MICRO PILLAR. PROPOSED MICRO PILLAR SHALL BE LOCATED A MINIMUM DISTANCE 2M FROM ESB MINI-PILLARS.
	EXISTING ESB NETWORKS MINIPILLAR AND/OR RECESSED VAULT
	PROPOSED ESB NETWORKS MINI-PILLAR & VC2 VAULT ARRANGEMENT
	PROPOSED (800x800) CONCRETE DRAW PIT / INSPECTION CHAMBER.
	DENOTES COLUMN MOUNTED PUBLIC LIGHTING LUMINAIRE
	DENOTES COLUMN MOUNTED PUBLIC LIGHTING LUMINAIRE

**NOTES RELATING TO STREET LIGHTING INSTALLATIONS:**

THE PUBLIC LIGHTING DESIGN SHALL FULLY COMPLY WITH BS5489:2013 LIGHTING CLASS P3.

THE CONTRACTOR SHALL NOTE THAT ALL PUBLIC LIGHTING DUCTING TO BE RED HIGH DENSITY POLYETHYLENE (HDPE) DUCTS STAMPED 'STREET LIGHTING' OR PUBLIC LIGHTING' AND BE IN ACCORDANCE WITH KILDARE COUNTY COUNCIL PUBLIC LIGHTING REQUIREMENTS.

CONTRACTOR SHALL ENSURE THAT ALL ESN SUPPLY POINTS, PUBLIC LIGHTING PILLARS, COLUMNS, DUCTS & CABLES ARE INSTALLED/PLACED OUTSIDE THE BOUNDARIES OF PRIVATE PROPERTY.

ALL COLUMNS SHALL BE OF TAPERED OCTAGONAL CONSTRUCTION, FABRICATED FROM 3mm SHEET STEEL OR OF TUBULAR STEEL CONSTRUCTION WITH A MINIMUM WALL THICKNESS OF 3mm. NO CIRCUMFERENTIAL BUTT-WELDING SHALL BE USED IN COLUMN CONSTRUCTION. COLUMNS SHALL COMPLY WITH SDCC STREET LIGHTING DIVISION REQUIREMENTS & SPECIFICATIONS.

COLUMNS SHALL HAVE FITTED COMPARTMENT DOORS SET AT A HEIGHT OF 1.5m TO CENTRE OF OPENING ABOVE FINISHED ROAD LEVEL AND NORMALLY FACED AWAY FROM ONCOMING TRAFFIC.

THE OUTSIDE OF THE PLANTED PORTION OF ALL COLUMNS SHALL BE PROTECTED BY A BITUMINOUS COATING EXTENDING TO A HEIGHT OF 150mm ABOVE GROUND LEVEL.


ALL DUCTS SHALL BE PLACED OUTSIDE THE BOUNDARIES OF PROPERTIES AND SHALL NOT AT ANY TIME PASS THROUGH ESB OR EIR TELECOM CHAMBERS.

THE CONTRACTOR SHALL ENSURE THAT SPARE 50mm DUCTS ARE LAID ACROSS ALL DRIVEWAY APRONS. SPARE 100mm DUCT SHALL BE PROVIDED AT EACH ROAD CROSSING. IN ALL SITUATIONS ELECTRICAL HAZARD WARNING TAPE AS PER ET10101:2020 SHALL BE LAID AT THE APPROPRIATE DEPTH.


CABLING DEPLOYED FOR STREET LIGHTING SHALL BE MINIMUM 2x6mm SQ NYCY COMPLYING WITH VDE 0271/5.

A BARE COPPER OR HOT DIP GALV IRON EARTH ROD 16mm DIA SHALL BE SUNK TO A MINIMUM DEPTH OF 1200mm ADJACENT TO EACH SERVICE PILLAR. EARTH RODS SHALL BE INSTALLED WITH SUITABLE INSPECTION BOXES TO FACILITATE INSPECTION OF THE EARTH CONDUCTOR CONNECTION TO THE ROD.

ELECTRICAL CONTRACTOR SHALL REFER TO KILDARE COUNTY COUNCIL GUIDELINES FOR PUBLIC LIGHTING WORKS AND ENSURE THAT THEIR INSTALLATION FULLY COMPLIES WITH THIS DOCUMENT.

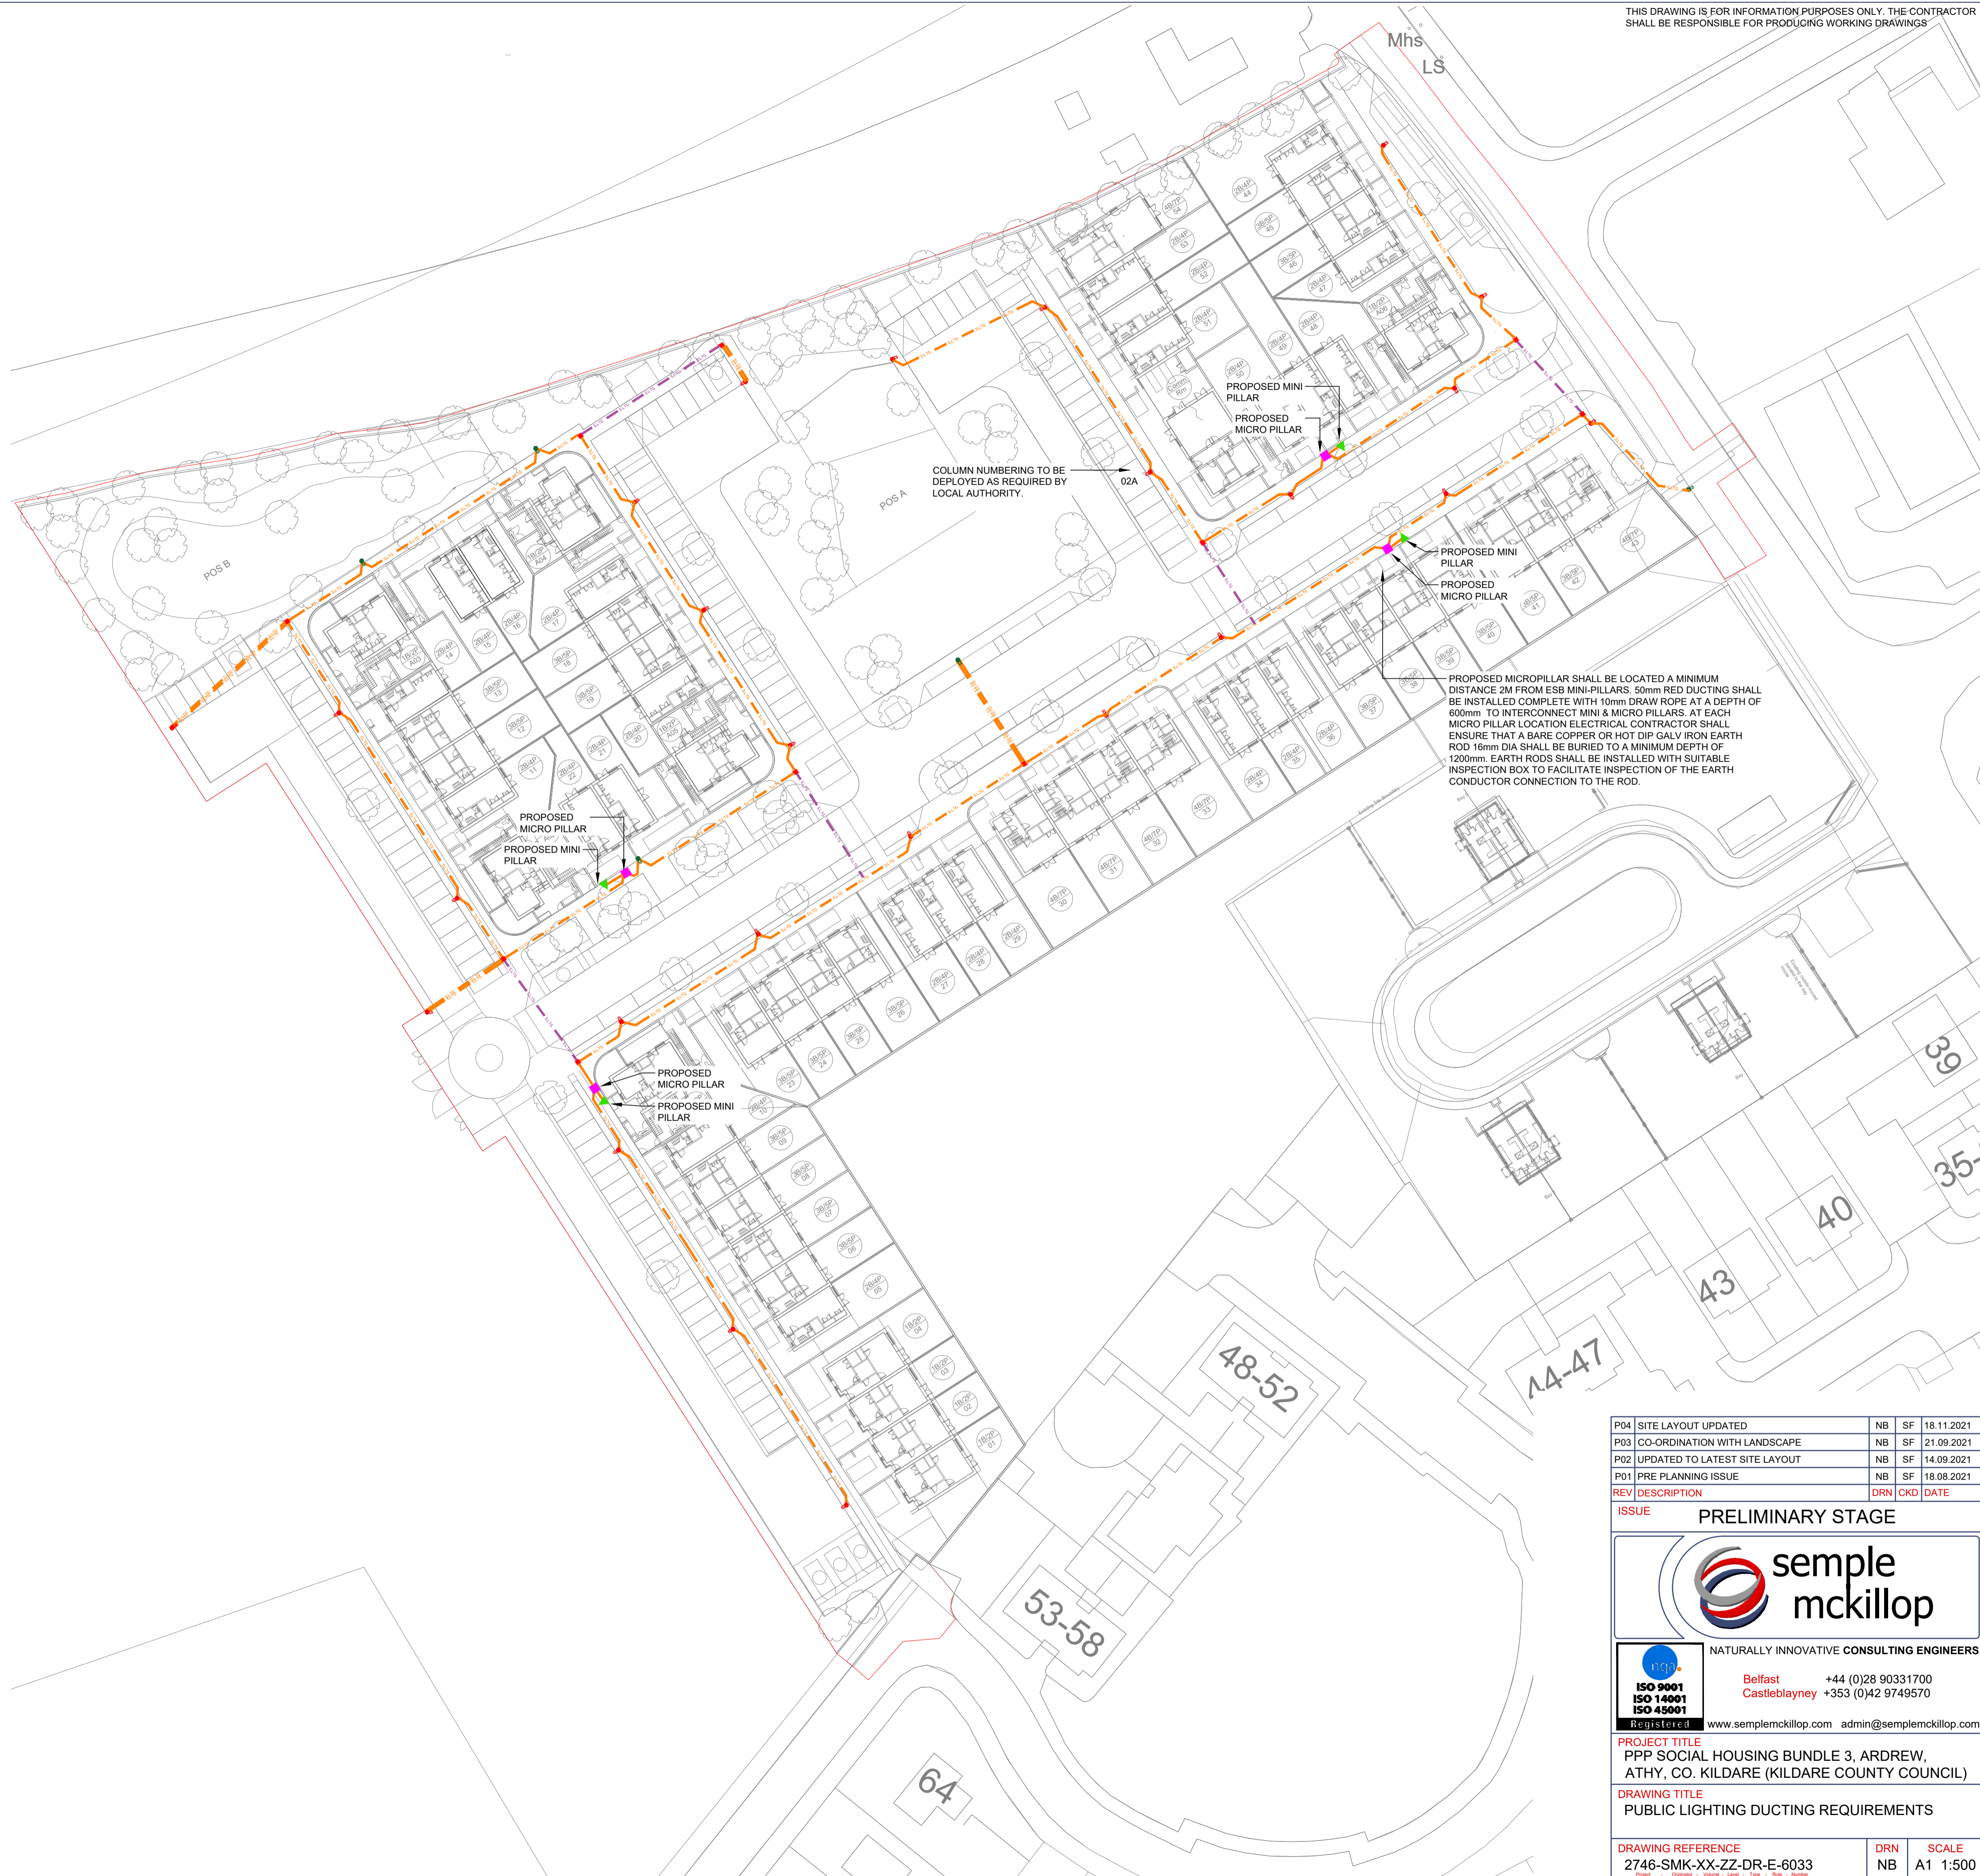

PROPOSED MICRO PILLAR SHALL BE LOCATED A MINIMUM DISTANCE 2M FROM ESB MINI-PILLARS. 50mm RED DUCTING SHALL BE INSTALLED COMPLETE WITH 10mm DRAW ROPE AT A DEPTH OF 600mm TO INTERCONNECT MINI & MICRO PILLARS. AT EACH MICRO PILLAR LOCATION ELECTRICAL CONTRACTOR SHALL ENSURE THAT A BARE COPPER OR HOT DIP GALV IRON EARTH ROD 16mm DIA SHALL BE BURIED TO A MINIMUM DEPTH OF 1200mm. EARTH RODS SHALL BE INSTALLED WITH SUITABLE INSPECTION BOX TO FACILITATE INSPECTION OF THE EARTH CONDUCTOR CONNECTION TO THE ROD.

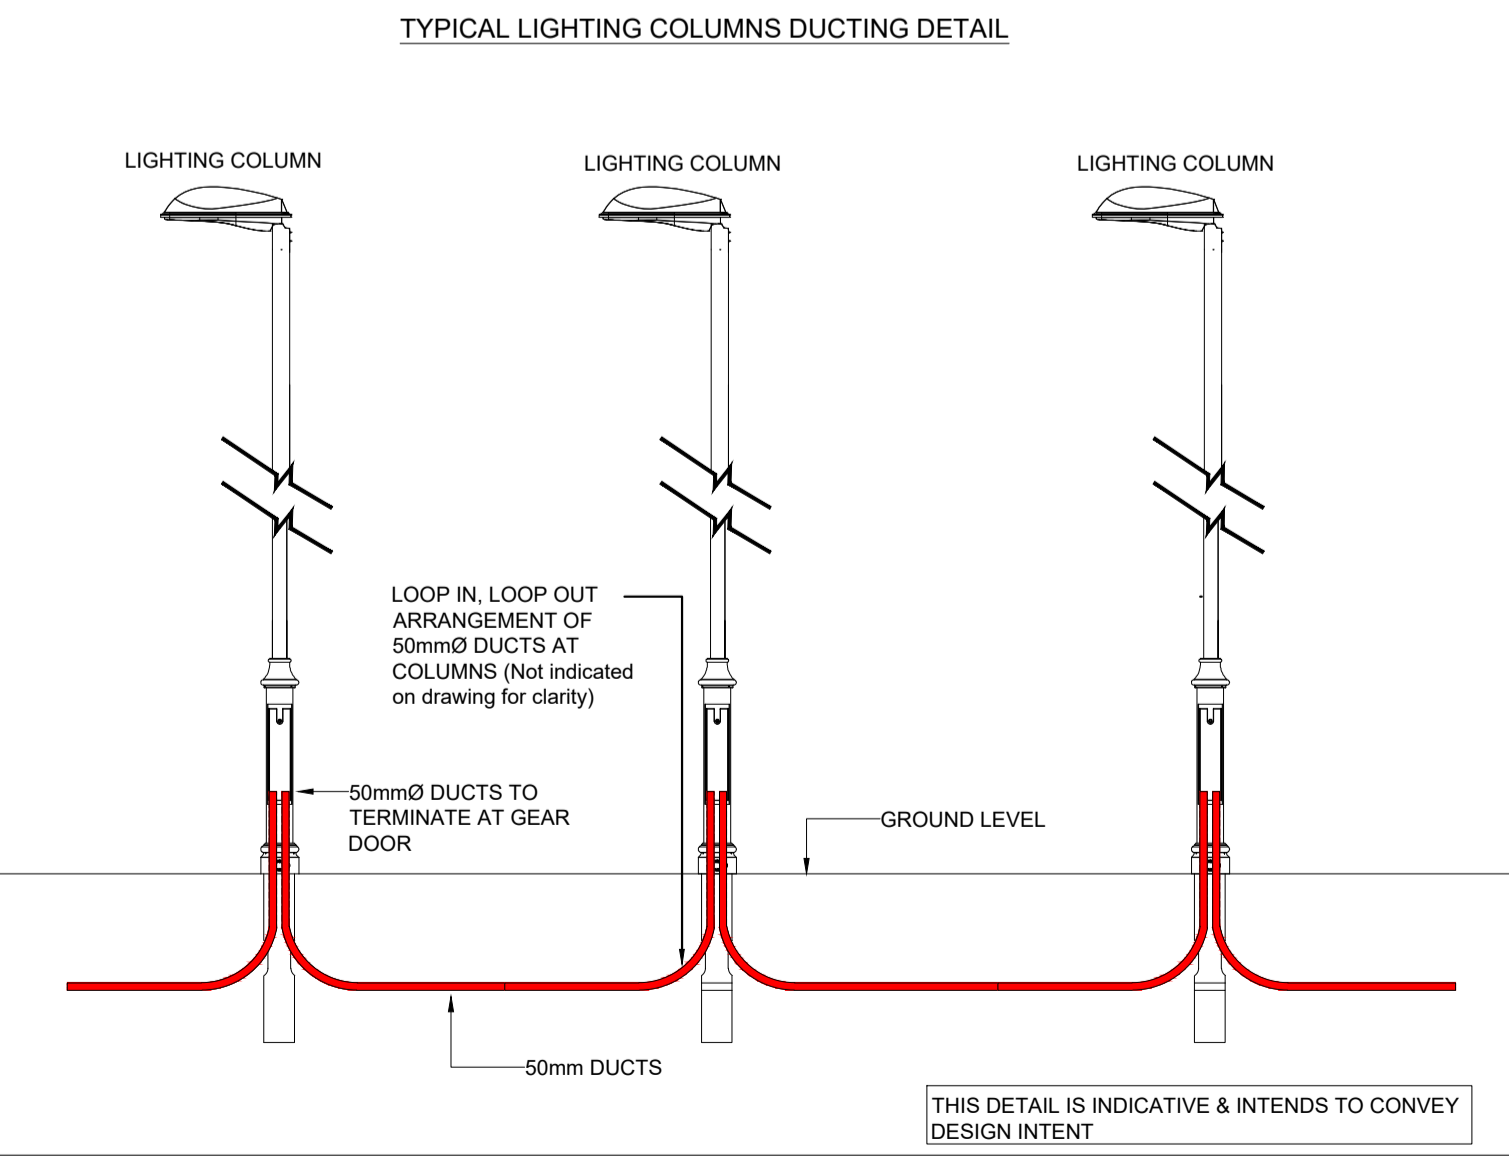

P04	SITE LAYOUT UPDATED	NB	SF	18.11.2021
P03	CO-ORDINATION WITH LANDSCAPE	NB	SF	21.09.2021
P02	UPDATED TO LATEST SITE LAYOUT	NB	SF	14.09.2021
P01	PRE PLANNING ISSUE	NB	SF	18.08.2021
REV	DESCRIPTION	DRN	CKD	DATE

ISSUE PRELIMINARY STAGE



**simple mckillop**

NATURALLY INNOVATIVE CONSULTING ENGINEERS

Belfast +44 (0)28 90331700  
Castleblayney +353 (0)42 9749570

Registered www.simplemckillop.com admin@simplemckillop.com

PROJECT TITLE  
PPP SOCIAL HOUSING BUNDLE 3, ARDREW, ATHY, CO. KILDARE (KILDARE COUNTY COUNCIL)

DRAWING TITLE  
PUBLIC LIGHTING DUCTING REQUIREMENTS

DRAWING REFERENCE	DRN	SCALE
2746-SMK-XX-ZZ-DR-E-6033	NB	A1 1:500